




OPTIMAX-TOP Ductless Air Handling Units

The OPTIMAX-TOP is a series of energy-efficient ductless air handling units that incorporate the latest thermal and ventilation technology. This series includes **4** unit types with airflows from **1,000 to 12,000 m³/h.**: **OPTIMAX-TOP-O**: Supply and exhaust unit with heat recovery. **OPTIMAX-TOP-NW**: Supply and exhaust unit with recirculation. **OPTIMAX-TOP-N**: Supply unit with recirculation. **OPTIMAX-TOP-R**: Recirculation unit. The high-efficiency rotary heat exchanger enables the recovery of thermal energy from exhaust air with up to **90%** efficiency. Additionally, the high-efficiency fans with **EC** motors are used to minimize electricity consumption. The double-skin panels are **50 mm** thick and insulated with mineral wool to reduce heat loss to the environment. They also provide excellent acoustic insulation for the working fans. **The OPTIMAX-TOP** air handling units come fully pre-wired with a built-in, pre-configured control panel. They are equipped with air distributors featuring swirl diffusers that provide direct air distribution to the serviced space, removing the need for additional ventilation ductwork. They are designed for use in facilities such as sports halls, warehouses, production halls, stores, and other large industrial and public-use spaces.

OPTIMAX-TOP-60

DIMENSIONS

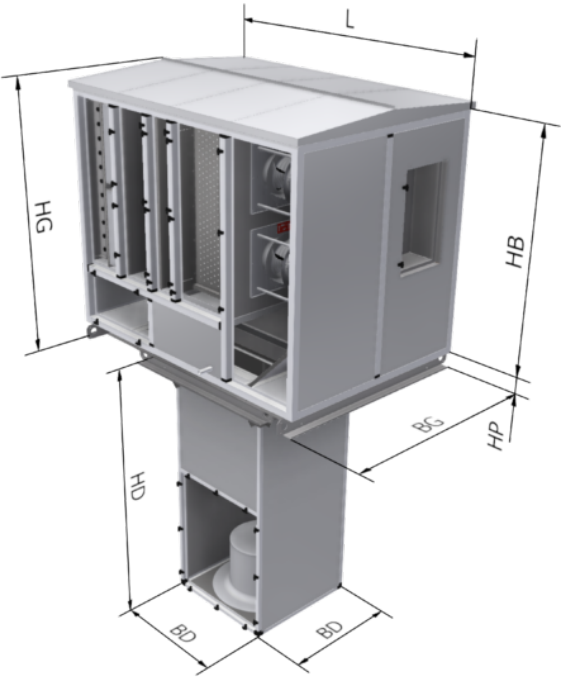


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BG [mm] | L [mm] | HD [mm] | BD [mm] |
| 1940 | 1700 | 120 | 1550 | 2150 | 2000 | 900 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department.
The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-90

DIMENSIONS

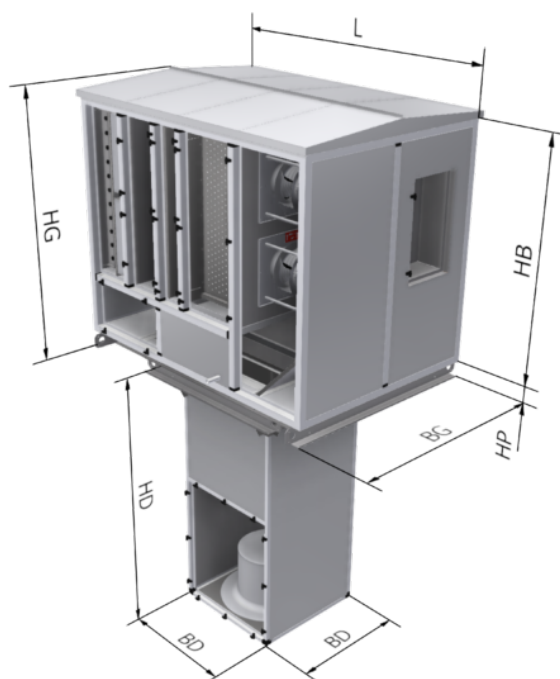


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BG [mm] | L [mm] | HD [mm] | BD [mm] |
| 2140 | 1900 | 120 | 1750 | 2250 | 2000 | 1100 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-NW-60

DIMENSIONS

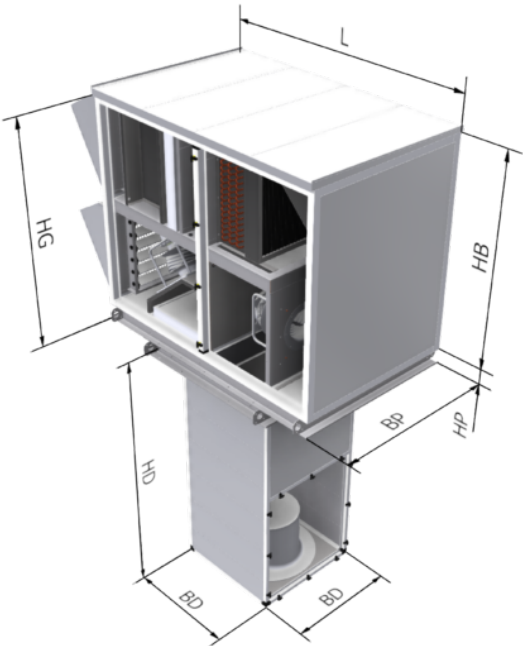


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BP [mm] | L [mm] | HD [mm] | BD [mm] |
| 1800 | 1600 | 120 | 1300 | 2050 | 2000 | 900 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-NW-90

DIMENSIONS

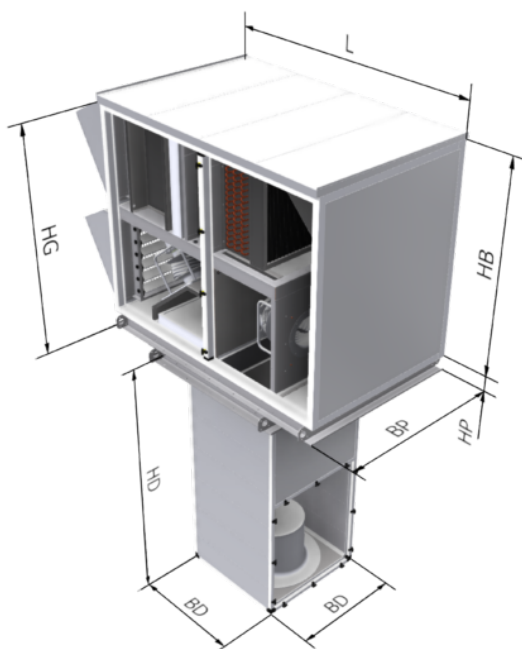


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BP [mm] | L [mm] | HD [mm] | BD [mm] |
| 2050 | 1850 | 120 | 1500 | 2250 | 2000 | 1100 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-N-60

DIMENSIONS

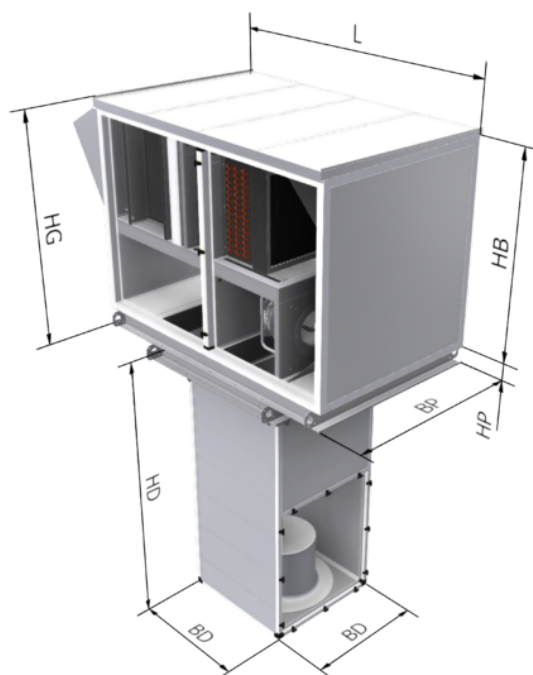


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BP [mm] | L [mm] | HD [mm] | BD [mm] |
| 1570 | 1400 | 120 | 1300 | 2050 | 2000 | 900 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-N-90

DIMENSIONS

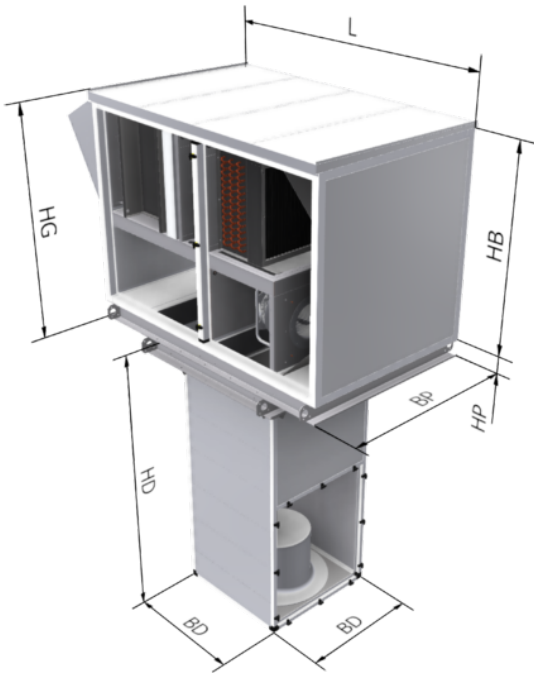


| Dimensions | | | | | | |
|------------|------------|------------|------------|-----------|------------|------------|
| HG [mm] | HB [mm] | HP [mm] | BP [mm] | L [mm] | HD [mm] | BD [mm] |
| 1780 | 1600 | 120 | 1500 | 2250 | 2000 | 1100 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department.
The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-R-25

DIMENSIONS

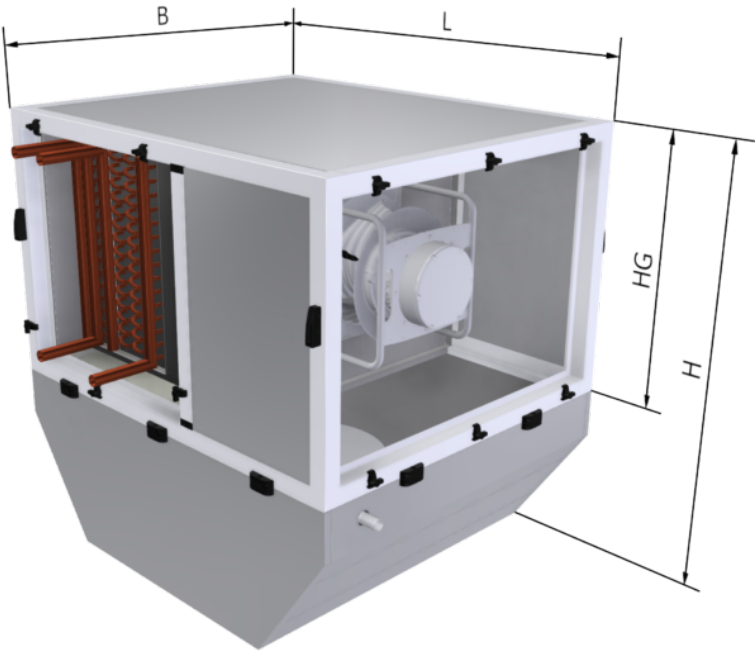


| Dimensions | | | |
|------------|-----------|-----------|-----------|
| HG [mm] | H [mm] | B [mm] | L [mm] |
| 600 | 1100 | 800 | 1200 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-R-40

DIMENSIONS

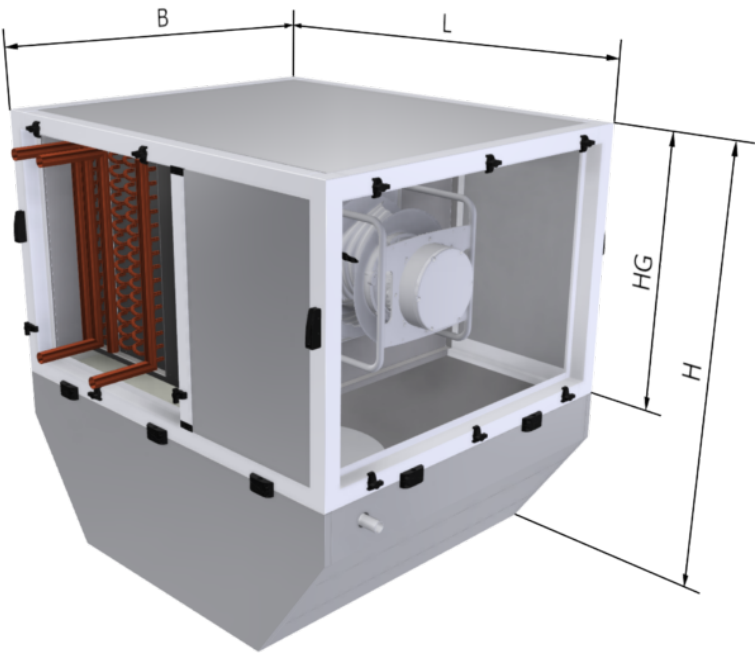


| Dimensions | | | |
|------------|-----------|-----------|-----------|
| HG [mm] | H [mm] | B [mm] | L [mm] |
| 800 | 1300 | 800 | 1200 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-R-60

DIMENSIONS

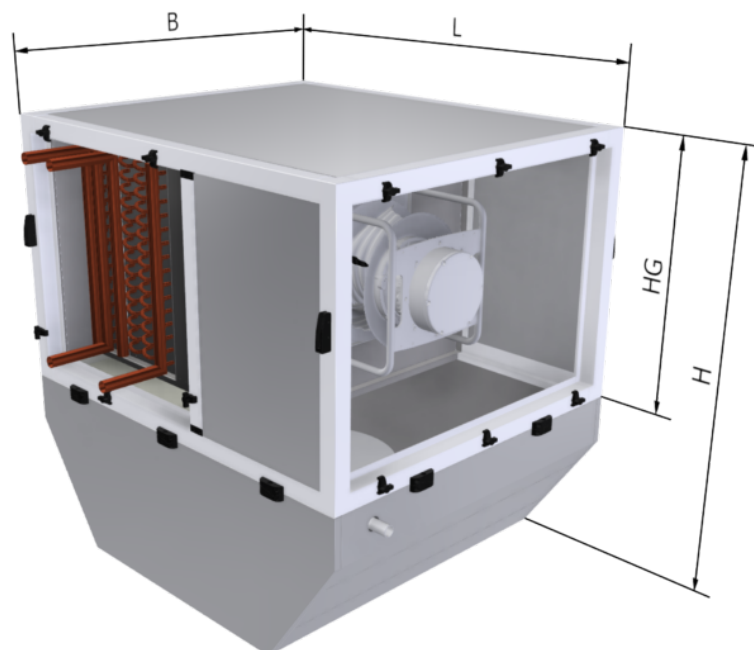


| Dimensions | | | |
|------------|-----------|-----------|-----------|
| HG [mm] | H [mm] | B [mm] | L [mm] |
| 800 | 1300 | 1100 | 1300 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-R-90

DIMENSIONS

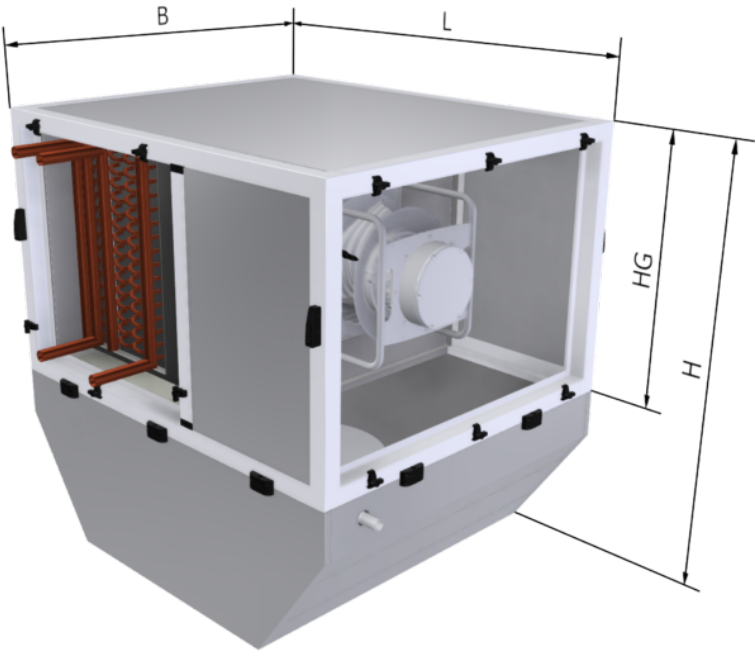


| Dimensions | | | |
|------------|-----------|-----------|-----------|
| HG [mm] | H [mm] | B [mm] | L [mm] |
| 1100 | 1700 | 1100 | 1300 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.

OPTIMAX-TOP-R-120

DIMENSIONS

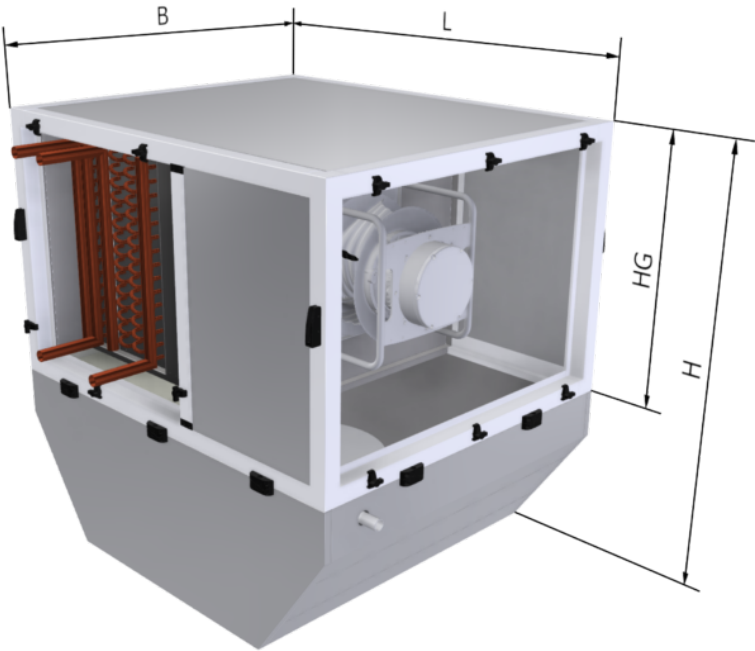

| Dimensions | | | |
|------------|-----------|-----------|-----------|
| HG [mm] | H [mm] | B [mm] | L [mm] |
| 1100 | 1700 | 1400 | 1300 |

The standard version of the AHU can be modified in terms of the materials used after consultation with our technical department. The modifications' scope must be approved during the quotation preparation stage.